




GOVERNMENT OF TRIPURA
DIRECTORATE OF FIRE & EMERGENCY
SERVICES
AGARTALA, TRIPURA



Phone: 0361-232-6451

Email: dg.fire-tr@gov.in

website:www.fireservice.tripura.gov.in

No: FSRTFES 2022/00137

Dated: 27/01/2023

To,
Pintu Debnath
Mohanpur, West Tripura
Bodhjungnagar B.O - 799210

Sub: Fire Safety Recommendation For Application Reference No FSRTFES/2022/00137 .

With reference to your Application Reference No FSRTFES/2022/00137 Dated 03/01/2023 Fire Safety Recommendation on fire prevention and fire safety measures of the following building/premises is hereby issued in accordance with the conditions laid down in the relevant portions of Part-IV of the latest National Building Code and the Tripura Building Rules.

Name of the Applicant:	Pintu Debnath				
Name of Owner with Plot details:	S. No.	Owner Name and Address			
	1.	দং- BLESSED ANDRE ENGLISH MEDIUM SCHOOL " ভিলেজ অ্যান্ডুরে ইংলিশ মেডিয়াম স্কুল সাং- BODHJUNG NAGAR ইউ.আই.ডি.নং :- xxxxxxxxxxxx			
		S. No.	Plot No	Total Area	Classification
		1.	2343	4.46	টিলা
		2.	2438	0.78	লুঙ্গা
		3.	2439	0.04	লুঙ্গা
Name of the Property/ Organization/ Commercial establishment:	Saint Andre English Medium School (Blessed)				
Address of the Building/ Premises:	Bhagaban Thakur Para Habitation, Bodhjungnagar Village Council, Lefunga Bac Block, Post Office Bodhjungnagar B.O - 799210, West Tripura District, Tripura.				

A Fire Safety Certificate (FSC) will be issued, subject to verification of compliance of fire prevention and fire safety measures on which the fire safety recommendations enumerated in the attached letter and further submission of application through online system.

Director,
Fire & Emergency Services,
Or Authorized Signatory
Tripura : Agartala

***** WE SERVE TO SAVE *****

This certificate shall not be used by the Insurance service provider

Fire Safety Advisory and Suggestion:

- 1. 1Nos staircase G+1 (New building)
- 2. Co2 2 Nos extinguisher of 4.5 kg capacity for G+1 (New building). 4 Nos extinguisher for G+2 (Old building) in front of electric panel box & science laboratory.
- 3. ABC extinguisher 2Nos of 6 kg capacity for G+1 (New building) 2Nos of 6kg capacity for G+2(Old building).
- 4. Hooter to be installed 2nos for G+1(New building) 2Nos for G+2 (Old building).
- 5. 2 Nos manually operated fire alarm to be installed with battery backup for G+1 (new building) & 2Nos for G+2 (Old building)
- 6. Sprinkler to be installed in science laboratory G+2 (Old building)
- 7. Firefighting inlet valve to be installed at G+1(New building) each floor & G+2 (Old building) each floor.
- 8. 2 Nos Delivery hose box to be installed at G+1 (New building) & 2 Nos for G+2 (Old building) along with fireman Axe.
- 9. Terrace level discharge pump-900LPM, with a minimum pressure of 3.5kg/cm² each at G+1 & G+2.
- 10. Terrace level head pump 50 meters each at G+1 & G+2.
- 11. Terrace level power supply should be in 3 (three) phases each at G+1 & G+2.
- 12. Auto pump controller to be installed terrace level pump along with and air release valve pressure gauge & pressure switch to be provided at the terrace level each at G+1 & G+2.
- 13. Terrace tank capacity 10,000 Liters, to be constructed in the building exclusively for firefighting purpose each at G+1 & G+2.
- 14. Standby power supply is required.
- 15. Trained person should be appointed to operate all the firefighting equipment in case of emergency.
- 16. unused combustible inflammable materials and explosive substance should not be storage anywhere in the building 17. fire extinguisher/ downcomer/ hose reel hose should not be installed near staircase landing.18. electrical diagram showing separate circuits of fire & life safety measures diagram will be used to verify, relevant compliance with the national building code, IS 1646 & for functional test of fire safety related equipment. Certificate of compliance with electrical rules and the diagram is to be signed by the electrical contractor, which is to be submitted/ uploaded at the time of applying for NOC online.

Signature Not Verified

Digitally signed by Signer Name

Date: 2023.01.27 16:14:22 IST



Government of Tripura
Directorate of Fire Service
Tripura, Agartala.

Phone: 0381-2326451. Fax: 0381-2324826. Email: dfireservicetripura@gmail.com. Website: www.fireservice.tripura.gov.in

No.3-8/TFS/2020/ 4390-92

Dated, Agartala, the 09th June, 2020.

To
The Principal,
Saint Andre English Medium School,
P.O. Bodhjungnagar, P.S. Lefunga,
West Tripura, Mobile No. 8837234256.

Subject: - Issuance of NOC.

With reference to your compliance report under letter No. Nil dated nil, it is hereby certified that the building /premises as per description below has been inspected by the officer concerned of this department. In respect of implementation of Fire Safety measures, it was found that said building have complied with the Fire Prevention and Fire Safety requirements in accordance with provisions of the Part-IV of the latest National Building Code, 2016. The premises/building is issued NOC with effect from 06/06/2020 for a period of 01 (one) year subject to compliance of the conditions for the validity of Fire NOC.

1. Name & address of the proposed building / premises :- The Principal, Saint Andre English Medium School, P.O. Bodhjungnagar, P.S. Lefunga, West Tripura.

Issued on 06/06/2020 at Agartala.


Joint Director,
Tripura Fire Service.


Conditions for the Validity of Fire NOC.

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all times. Any lapse in this regard shall make the owner /management liable for action.
2. There should not be any change of Trade for which this License has been issued.
3. Building sanctioning authority may verify any deviation with regard to the construction / occupancy in the building. In case of any deviation, the Fire Safety Certificate stands null and void.
4. Water reservoir should always be kept full up to the brim.
5. The entrance and exit and the water reservoir should always be free from any obstructions.
6. The staff shall be trained for operating fire fighting system and mock evacuation drills be Conducted at regular intervals and record be maintained.

Copy to :-

1. The Divisional Fire Officer, West Division, Agartala for information.
2. OC, Agartala Fire Station for favour of Information.

***** WE SERVE TO SAVE *****

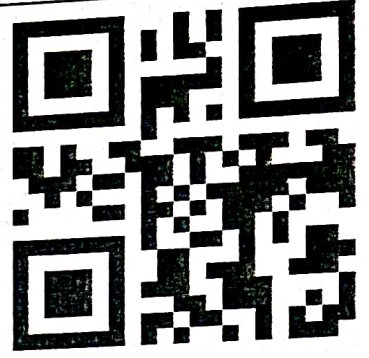

GOVERNMENT OF TRIPURA
DIRECTORATE OF FIRE & EMERGENCY SERVICES
AGARTALA : TRIPURA

Phone: 0381-232-6451

Email: dg.fire-tr@gov.in

website:www.fireservice.tripura.gov.in

Application Reference No: FSRTFES/2022/00137

Dated: 07/09/2022

ACKNOWLEDGEMENT CUM MONEY RECEIPT

Applicant's Details			
Name	Pintu Debnath		
Mobile	9862698378	E-Mail	saintandre@rediffmail.com
Building Address	Bhagaban Thakur Para Habitation, Bodhjunnagar Village Council, Lefunga Bac Block, Post Office Bodhjunnagar B.O - 799210, West Tripura District, Tripura.	Police Station	Lefunga

Payment Details:

GRN 22160AA817
CIN 98944885
Txn Date 09/06/2022
Amount 3000.00
Status Success

Fees paid is non refundable

For
Directorate of Fire & Emergency Services

Annexures Details

Type of document(s)	Document(s) Attached
Other	Other
Power of Attorney/ Authorization Letter	Power of Attorney/ Authorization Letter
Existing Building Plans	Existing Building Plans
Drawings of the proposed fire protection arrangements	Drawings of the proposed fire protection arrangements